DMSA C400-04
Door to Storage Area

DMSA C400-04
Inside Storage Area

DMSA C-331-10

Lamp Starter in Fluorescent Light Fixture Removed from DMSA C-331-10.

DMSA
C-331-15
10/1999

October 1999
DMSA C-331-15

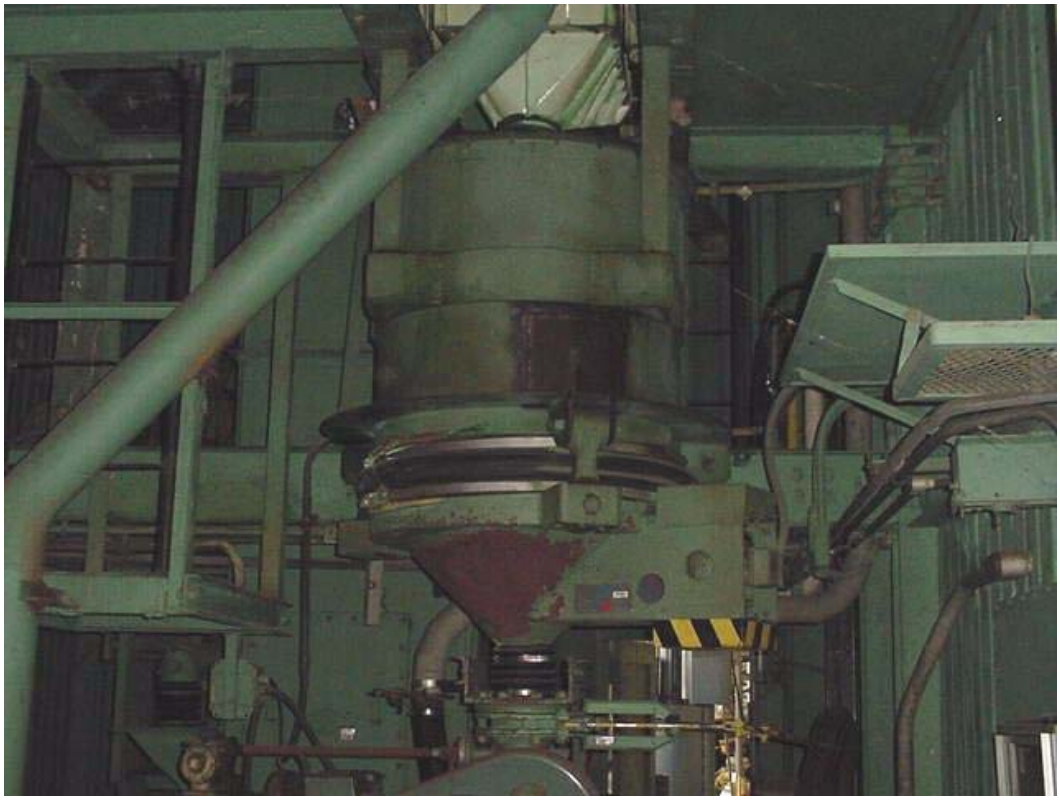

NOTICE
OUT OF
SERVICE
DO NOT ENTER
DO NOT
ENTE

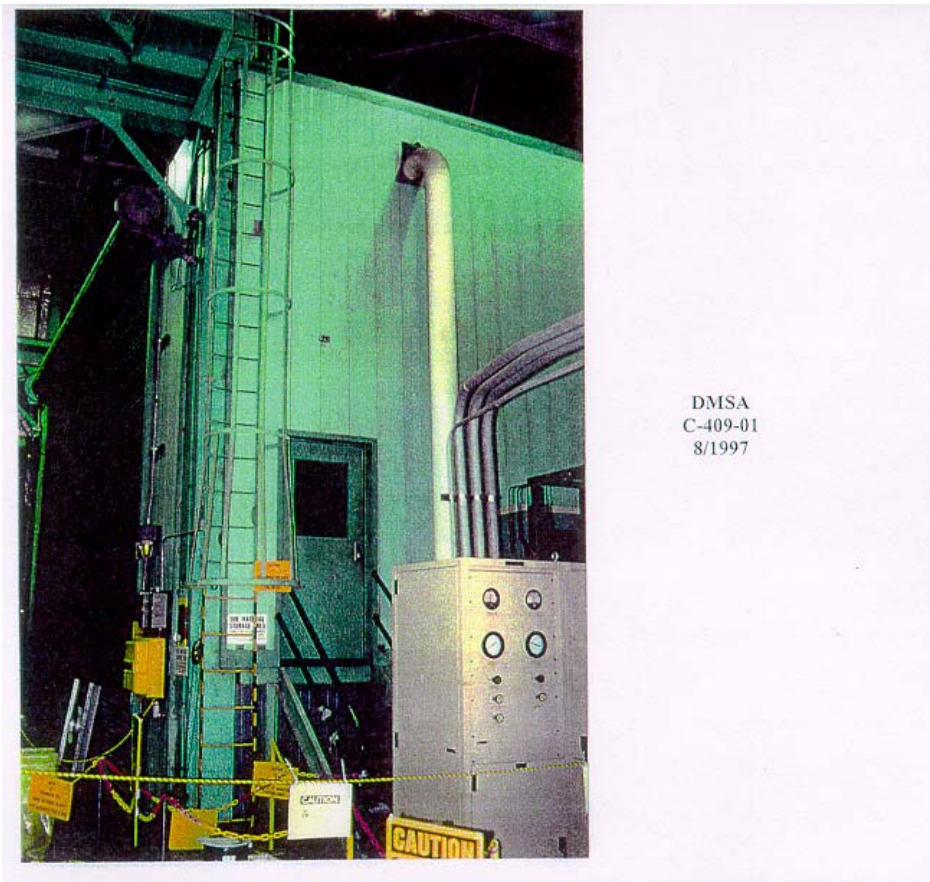
DMSA
C-409-01
8/1997
CAUTION

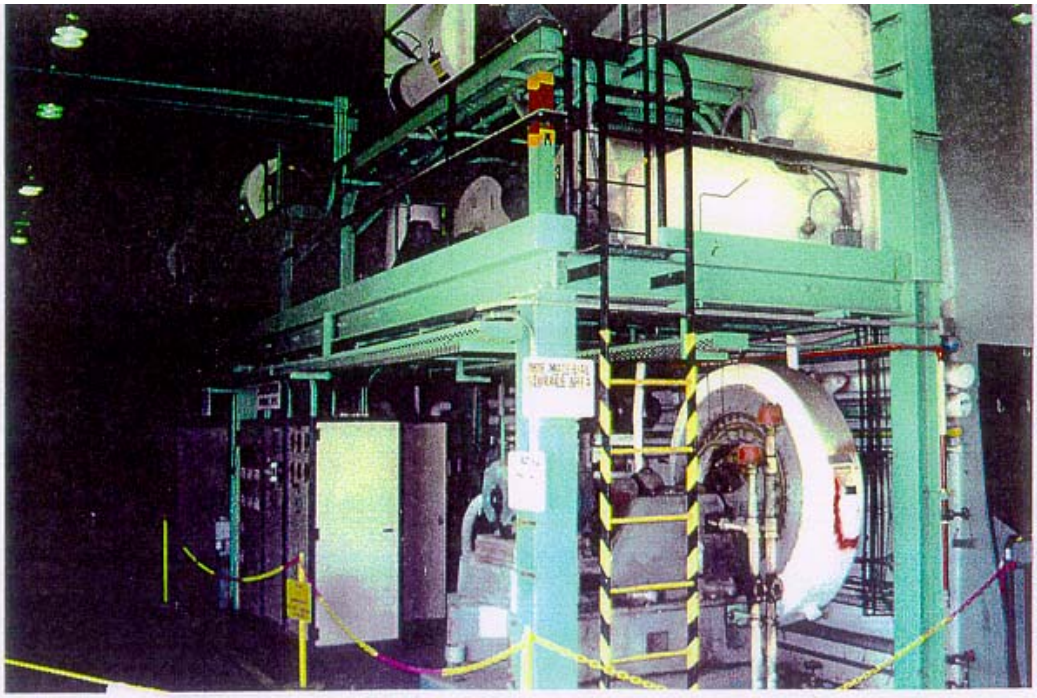

DMSA
C-409-02
8/1997

August 1997
DMSA C-409-02

February 2002
C-746-H3 Row I-07

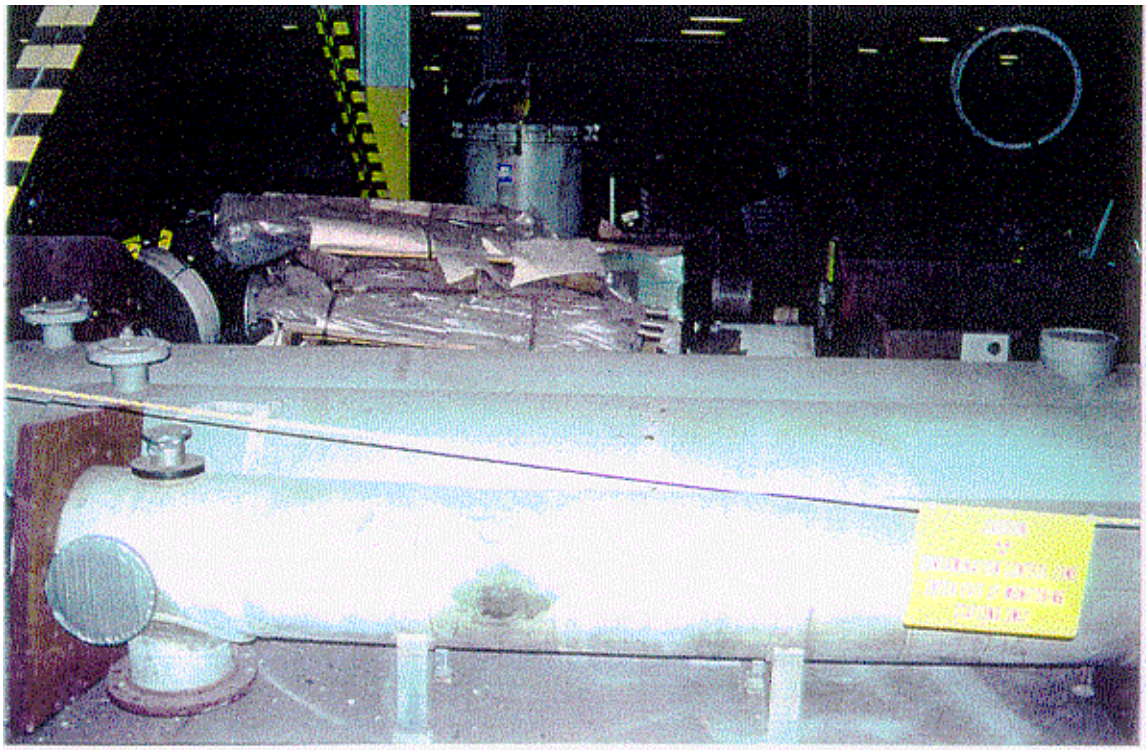

DMSA
C-331-14
10/1999

October 1999
DMSA C-331-14